Official Journal
of the European Union

EN
L series

2024/90664


31.10.2024

Corrigendum to Commission Delegated Regulation (EU) 2024/1364 of 14 March 2024 on the first phase of the establishment of a common Union rating scheme for data centres

(Official Journal of the European Union, L, 2024/1364, 17 May 2024)


On page 11, at point 1(k) in Annex II, Figure 3, Measurement of waste heat temperature:

for: ‘

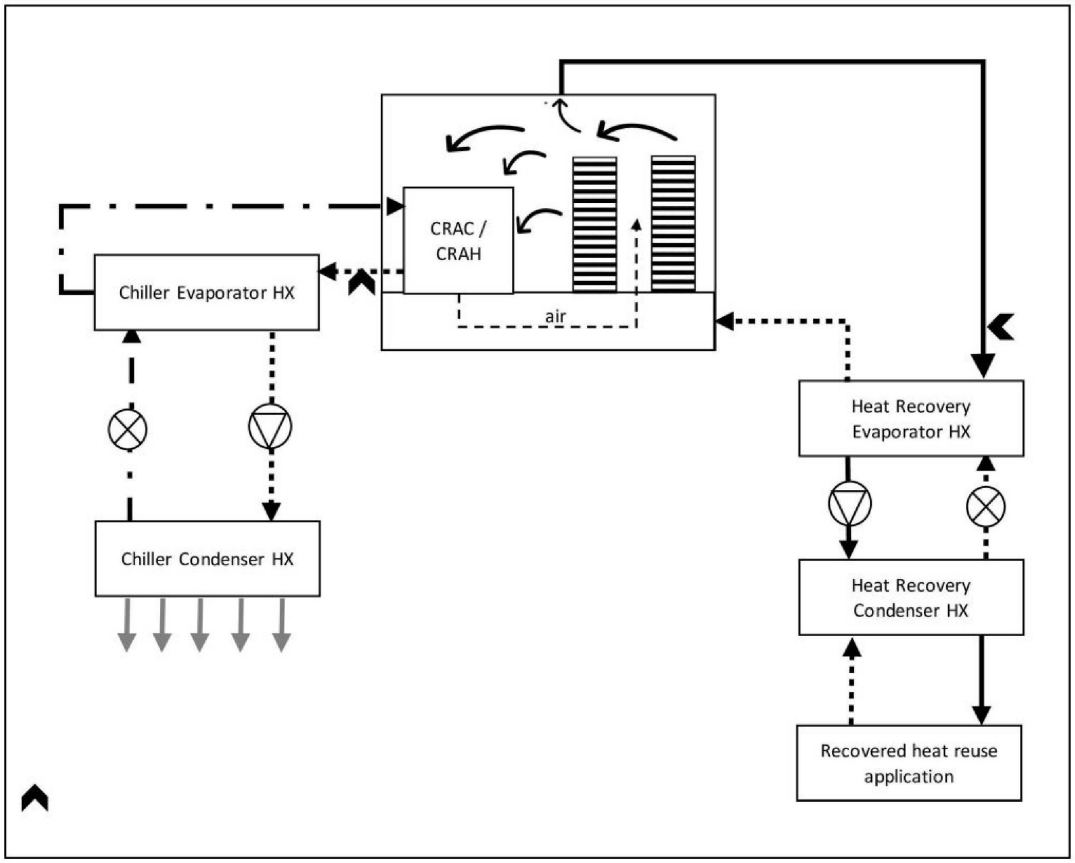

’

read: ‘

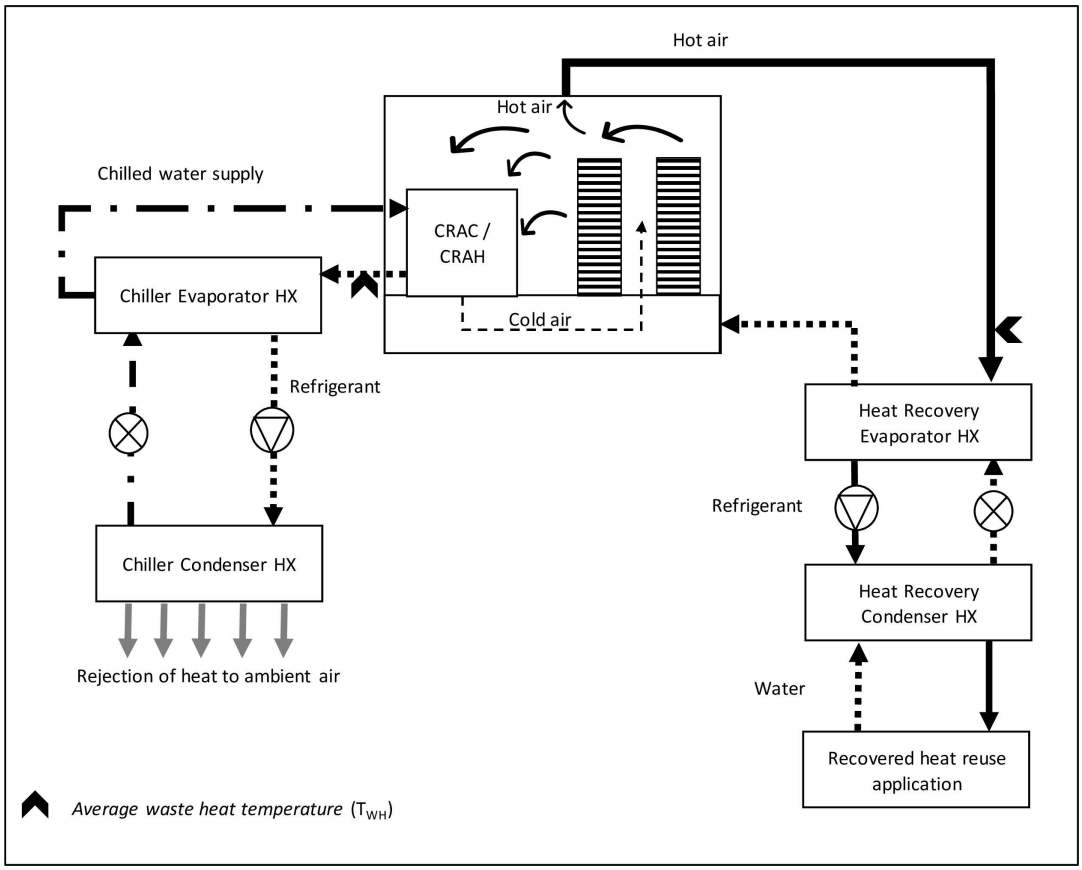
Hot air
Hot air
Chilled water supply
CRAC / CRAH
Chiller Evaporator HX
Cold air
Refrigerant
Heat Recovery Evaporator HX
Refrigerant
Chiller Condenser HX
Heat Recovery Condenser HX
Rejection of heat to ambient air
Water
Recovered heat reuse application
Average waste heat temperature (T_{WH})

’.